

2604

MODEL



Advanced Process Controller/ Programmer


Specification Sheet

- **3 Control loops**
- **SP Programmer**
- **Customisable user interface**
- **Maths and logic functions**
- **Open communications**

The 2604 is a highly accurate and stable process controller available in a single, dual or triple loop format. Features include setpoint programming and comprehensive selection of maths and logic functions.

It has a dual 5digit display of process value and setpoint with an LCD panel for display of alarm messages, programmer and loop status information. User defined messages in the LCD panel simplify operation. The 2604 is a highly configurable product offering many features previously found only in programmable logic controllers. This allows systems to be implemented integrating the process control and logic functions of a machine, therefore simplifying system complexity and reducing the total system costs.


Configuration is achievable either via the front panel or using Eurotherm's iTools configuration software.

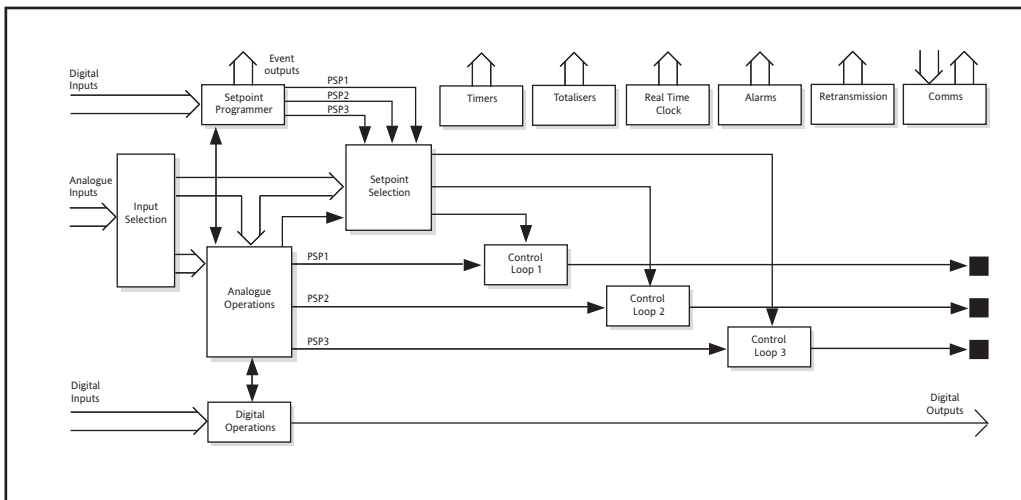

Control functions

- 3 Control loops
- PID, VP or ON/OFF
- Cascade, ratio or override
- Gain scheduling
- Configurable control strategies


Eurotherm's advanced control algorithm gives stable straight-line control. Automatic tuning simplifies the commissioning procedure by performing a one shot tune to calculate the optimum PID values. To further optimise control especially in programmer applications, gain scheduling can be used to transfer control between up to six sets of PID values.

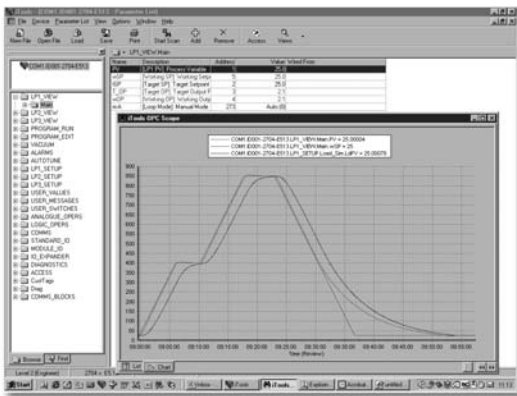

iTools configuration software

IO Hardware

- 0.25uV PV input resolution
- Fixed and modular IO
- 250Vac isolation
- Expandable IO
- Easily upgraded

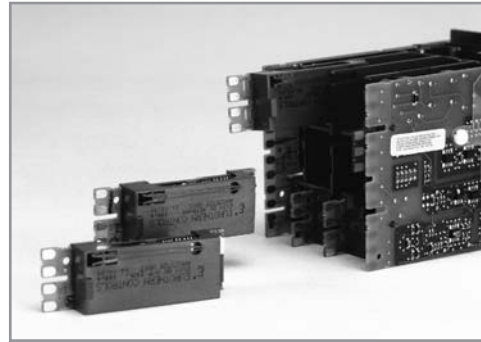

The 2604 incorporates a self correcting input circuit (INSTANT ACCURACY) to maximise accuracy and performance during initial warm up and changes in ambient temperature.

One universal and one high level analogue inputs, along with 10 digital IO are included as standard. Additionally, a further 5 IO modules may be fitted providing very flexible input/output combinations. The series 2000IO expander unit can provide an additional 20 digital inputs and 20 digital outputs.

Setpoint programmer

- 50 Programs
- 3 Profiled setpoints/program
- 500 Segments
- 16 Event outputs


Ideal for applications such as atmosphere or vacuum furnaces, and environmental chambers. The 2604 user interface offers the user an extremely easy method of editing, selecting and running programs.



Dual temperature/carbon programmer

iTools setpoint program editor

- Offline or online editing on PC
- Graphical representation
- Advanced editing functions
- Storage and retrieval of program files

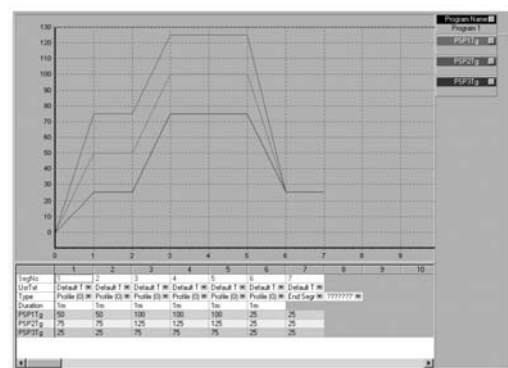

iTools setpoint program editor


Toolkit functions

- Mathematical calculations
- Combinational logic
- Real time clock
- Timer functions

Operators include;

Add, Subtract, Log, Exp, SQRT, AND, OR
Max, Min, Select and many more

ToolKit blocks allows the user to create custom solutions by internally wiring analogue and digital operations together in flexible ways. 24 analogue and 32 digital operations are available. Other functions are available including timers, totalisers and a real time clock.

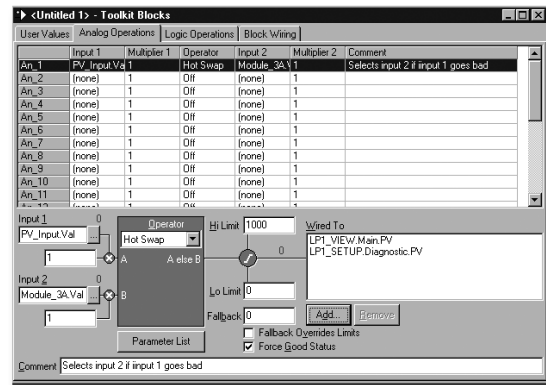


iTools toolkit block editor

I/O Expander

- 20 Logic inputs
- 20 Relay outputs

The 2000IO expander can increase the digital IO providing the option for greater remote operation of the programmer and expands the 2604 logic capability.

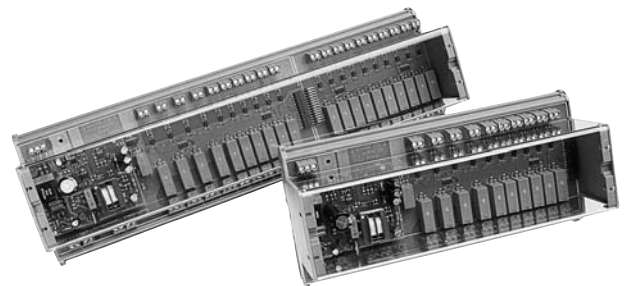


Slave communications

- Modbus™ RTU
- Profibus® DP
- DeviceNet®
- EI-Bisync

The 2604 supports two slave communication ports. Its modular build provides the user with a selection of communication protocols allowing easy integration into both PLC and PC supervisory systems.

When using Profibus DP a GSD file has to be created, containing the information relating to the instruments parameters, that a Profibus master needs in order to communicate with its slave device. The GSD file for a 2604 is created using Eurotherm's GSD file editor.

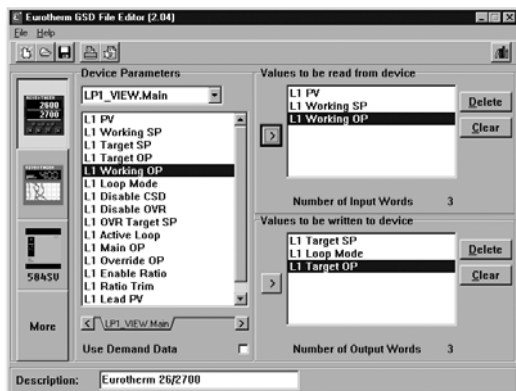


Profibus GSD editor

Master communications

- Modbus protocol
- 25 read/write parameters
- Expands available hardware
- Interfaces to most Modbus slaves


Master Modbus communications significantly increases the applications open to 2604. In its simplest form it can be used to retransmit a setpoint to a number of slave controllers in a multi-zone furnace.

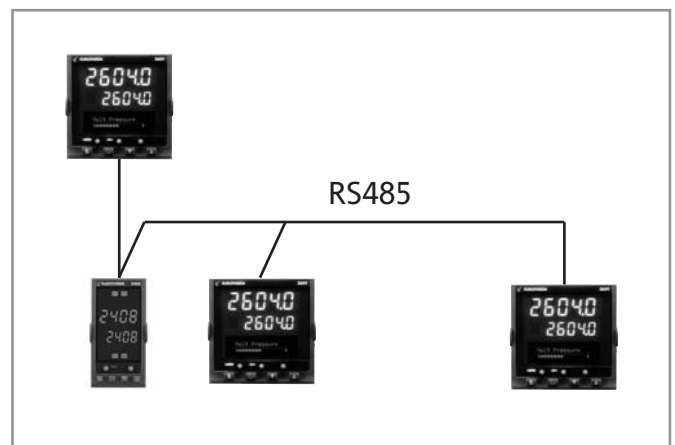

% Relative humidity

- %RH or Dewpoint Measurement
- Pressure compensation
- Boost heat/cool
- Compressor timer
- Cooling bypass output


Ideal for use in applications where it is necessary to simulate the environmental conditions of temperature, humidity, altitude or light. The setpoint programmer is used to generate synchronised profiles of up to three variables. Other options allow configuration of signals to turn on a compressor, operate a bypass or operate further stages of heating and cooling.

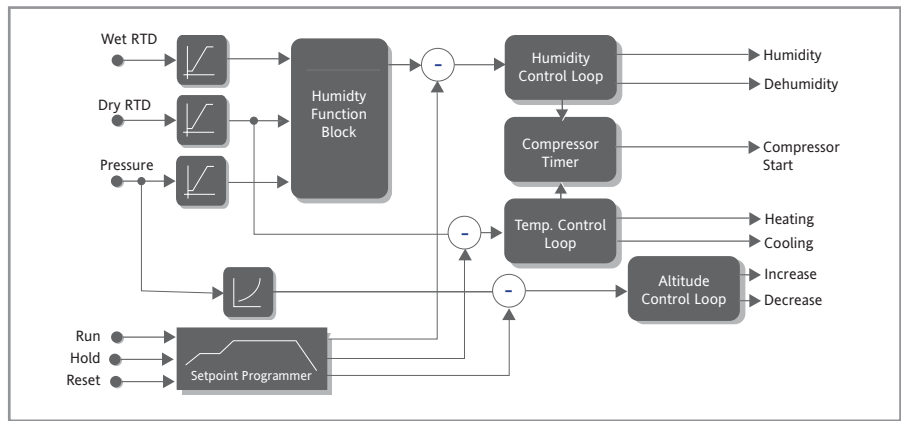

Carbon potential

- %CP, O₂ or Dewpoint measurement
- CO correction
- Probe burn off and sooting alarm
- Sooting alarm


Ideal for use in gas carburising furnaces where Zirconia probes are used to measure Carbon Potential. A three loop controller can be used to control furnace temperature, carbon potential and quench. The setpoint programmer is used in batch applications to generate synchronised temperature and carbon profiles.

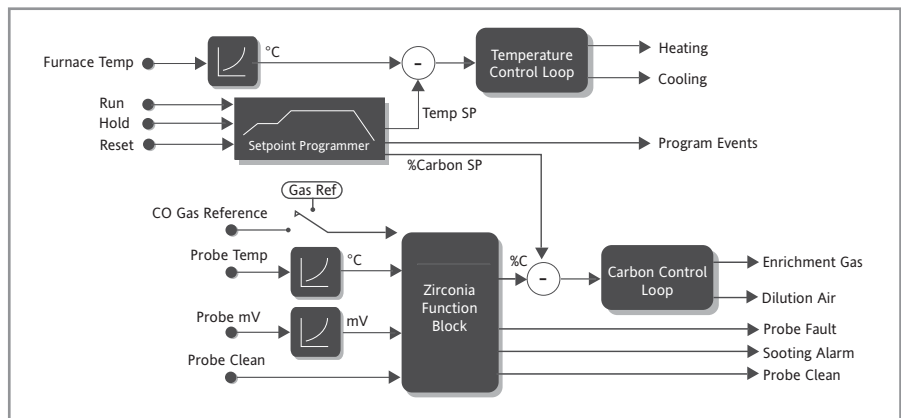

Melt pressure

- 350Ω Strain gauge input
- Transducer excitation
- Pressure alarms
- Screen blockage alarm
- Simple user calibration with shunt

Suitable for precision pressure control in the plastic extrusion industries. Additionally a second pressure transducer can be used to provide a differential pressure alarm when the screen starts to block. Various machine start up strategies can be used to ensure a smooth transition from auto to manual mode.

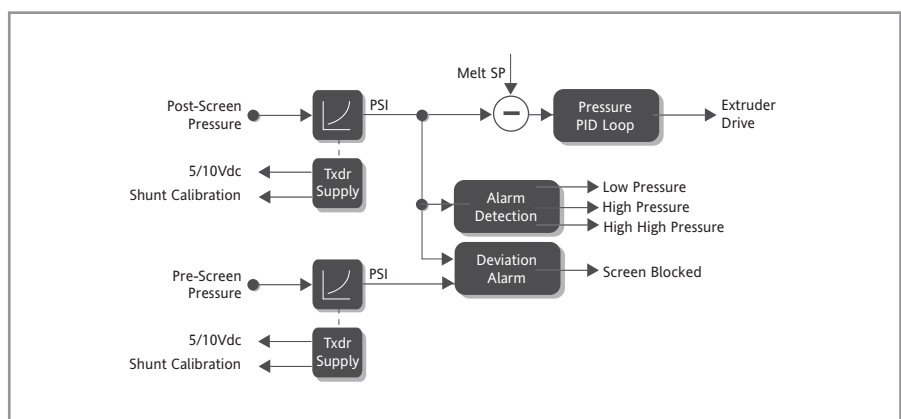

TECHNICAL SPECIFICATION

General

Environmental performance

Temperature limits	Operation: 0 to 50°C Storage: -10 to 70°C
Humidity limits	Operation: 5 to 95% RH non condensing Storage: 5 to 95% RH non condensing
Panel sealing:	IP65, Nema 4X
Vibration:	2g peak, 10 to 150Hz
Altitude:	<2000 metres
Atmospheres:	Not suitable for use in explosive or corrosive atmosphere

Electromagnetic compatibility (EMC)

Emissions and immunity BS EN61326

Suitable for domestic, commercial and light industrial as well as heavy industrial. (Domestic/light (Class B) emissions. Industrial (Class A) environmental immunity emissions.

With Ethernet module fitted product only suitable for Class A emissions.

Electrical safety

BS EN61010 Installation cat. II; Pollution degree 2

INSTALLATION CATEGORY II

The rate impulse voltage for equipment on nominal 230V mains is 2500V.

POLLUTION DEGREE 2

Normally, only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation shall be expected

Physical

Panel mounting:	1/4 DIN
Dimensions and weight:	96W x 96H x 150D mm, 600g
Panel cut-out dimensions:	92W x 92Hmm

Control options

No. of loops:	1, 2 or 3 loops
Options:	Cascade, Ratio or Override
Modes:	PID, ON/OFF or Valve Position
Applications:	Carbon Potential, Humidity

Approvals

CE, cUL listed (file E57766), Gost
Suitable for use in Nadcap and
AMS2750D applications under System
Accuracy Test calibration conditions

Standard I/O

Precision PV input	
Accuracy:	±0.1%
Ranges:	mV, mA, volts or RTD (PT100)
Thermocouple types:	J, K, I, N, R, S, B, PII, C, plus others
Cold junction:	Ext 0°C, 45°C or 50°C

Analogue input

Allocation:	1 fitted
Accuracy:	± 0.1%
Ranges:	-10V to 10V or 0 to 20mA

Digital I/O

Types:	1 digital input 7 Bi-directional input/outputs 1 Changeover relay
--------	---

Modules

Digital outputs

Types:	Single Relay, Dual Relay, Single Triac, Dual Triac, Single Logic and Triple Logic module
Allocation:	Slot 1, 3, 4, 5 or 6 (Max 3 Triacs per unit)

Digital inputs

Types:	Triple contact input, Triple logic input
Allocation:	Slot 1, 3, 4, 5 or 6

Analogue outputs

Types:	DC Control or DC Retransmission (5 Max)
Allocation:	Slot 1, 3, 4, 5 or 6
Range:	0 to 20mA or 0 to 10Vdc

Dual Analogue outputs

Allocation:	Slot 1, 4 or 5
Range:	4-20mA or 24Vdc transmitter PSU

High Resolution Analogue output

Allocation:	Slot 1, 4 or 5
Range:	4-20mA and 24Vdc transmitter PSU

Transmitter PSU

Allocation:	Slot 1, 3, 4, 5 or 6
Transmitter:	24Vdc @ 20mA

Transducer supply

Bridge voltage:	Software selectable, 5 or 10Vdc
Bridge resistance:	300Ω to 15Kohms

Potentiometer input

Potentiometer resistance 330Ω to 150kohms

Precision PV input (Module)

Allocation:	Slot 3 or 6
Accuracy:	±0.1%
Ranges:	mV, mA, volts or RTD (PT100)
Thermocouple types:	J, K, T, L, N, R, S, B, PII, C, plus others
Cold junction:	Ext 0°C, 45°C or 50°C

Dual (Probe) input

Allocation:	Slot 3 or 6
Accuracy:	±0.1%
Ranges:	mV, mA, volts or RTD (PT100)
Thermocouple types:	J, K, T, L, N, R, S, B, PII, C, plus others
Cold junction:	Ext 0°C, 45°C or 50°C

Analogue input (module)

Allocation:	Slot 1, 3, 4 or 6
Accuracy:	±0.2%
Ranges:	mV, mA, volts or RTD (PT100)
Thermocouple types:	J, K, T, L, N, R, S, B, PII, C, plus others
Cold junction:	Ext 0°C, 45°C or 50°C

Setpoint Programmer

No profiles:	1, 2 or 3 profiles
No. of programs:	50 programs max.
No. of segments:	500 time to target segments (max.) or 400 ramp rate segments (max.)

Event outputs: Up to 16

I/O Expander

10 I/O version:	4 Changeover and 6 normally open relay contacts 10 Logic inputs
20 I/O version:	4 Changeover and 16 normally open contacts 20 Logic inputs

Advanced Functions

Application blocks:	32 digital operations 24 analogue operations 12 user values
Timers:	4 ON pulse, OFF delay, one shot and min-ON
Totalisers:	4, trigger level and reset input
Pattern generators:	16 patterns each with 16 bits
Real time clock:	Day of the week and time
Customisable screens:	8 user screens
User switches:	8, toggle and momentary function

Slave communications

Allocation:	Slot H or J (DeviceNet/Profibus slot H only)
Types:	Profibus DP RS485 Modbus RTU RS485 (2 wire) RS485 (5 wire) or RS232 DeviceNet EI-Bisyc (subset of parameters)

Master communications

Allocation:	Slot J
Types:	Modbus RTU RS485 (2 wire), RS485 (4 wire) or RS232
Parameters:	25 read/write

Ordering code

Hardware coding

Controller Type	Supply Voltage	Loop/Programs	Applications	I/O slot 1	I/O slot 3	I/O slot 4

Controller Type	Loop/Programs	I/O slots 1,3,4,5,6
2604 Standard 2604f Profibus	First digit 1- One loop 2- Two loops 3- Three loops Second digit -XX No programs -2- Twenty programs -5- Fifty programs Third digit -XX No programs -1 1 Profile -2 2 Profile -3 3 Profile	XX None fitted R4 Change over relay R2 2 Pin relay RR Dual relay T2 Triac TT Dual triac D4 DC Control D6 DC retransmission PV PV Input (Slots 3 & 6 only) TL Triple logic input TK Triple contact input TP Triple logic output MS 24Vdc t'mitter. PSU VU Pot. input G3 5Vdc t'ducer PSU G5 10Vdc t'ducer PSU AM Analogue input module (not in slot 5) DP Dual DC (probe) input ⁶ (Slots 3 and 6 only) DO Dual 4-20mA OP/24Vdc PSU (Slots 1, 4 & 5 only) LO Iso. single logic OP HR Hi Resolution DC retrans & 24Vdc PSU (Slots 1, 4 & 5 only)
Supply Voltage VH 85-264Vac VL 20-29Vac/dc	Applications XX Standard ZC Zirconia	

Example ordering code


2604 - VH - 323 - XX - RR - PV - D4 - TP - PV - XX - A2 - XX - ENG - U1 - IT

This code describes a 3 loop controller with capability to store 20 three profile programs.
 Supply voltage is 85-264Vac.
 Modular hardware: 2 x PV input, 1 x Dual relay, 1 x DC control, 1 x Triple logic output,
 EIA-232 Comms. 16 analogue and 16 digital operations, iTools supplied with controller

Configuration coding (optional)

Loop Function			Process Inputs			Analogue Input
Loop 1 Type	Loop 2 Type	Loop 3 Type	Loop 1 PV	Loop 2 PV	Loop 3 PV	Analogue Input

Loop Function	Process Inputs (Input type)																							
XXXX None S Standard PID C Cascade R Ratio O Override(?) PID PID control ONF On/Off control PIF PID/OnOff control VP1 VP without feedback VP2 VP with feedback	<table border="1"> <thead> <tr> <th>Custom downloads (replace C)</th> </tr> </thead> <tbody> <tr><td>Q</td><td>Custom curve</td></tr> <tr><td>D</td><td>D thermocouple</td></tr> <tr><td>E</td><td>E thermocouple</td></tr> <tr><td>1</td><td>Ni/Ni18%Mo</td></tr> <tr><td>2</td><td>Pt20%Rh/Pt40%Rh</td></tr> <tr><td>3</td><td>W/W26%Re (Engelhard)</td></tr> <tr><td>4</td><td>W/W26%Re (Hoskins)</td></tr> <tr><td>5</td><td>W5%Re/W26%Re (Engelhard)</td></tr> <tr><td>6</td><td>W5%Re/W26%Re (Bucose)</td></tr> <tr><td>7</td><td>Pt10%Rh/Pt40%Rh</td></tr> <tr><td>8</td><td>Exergen K80 I.R pyrometer</td></tr> </tbody> </table>	Custom downloads (replace C)	Q	Custom curve	D	D thermocouple	E	E thermocouple	1	Ni/Ni18%Mo	2	Pt20%Rh/Pt40%Rh	3	W/W26%Re (Engelhard)	4	W/W26%Re (Hoskins)	5	W5%Re/W26%Re (Engelhard)	6	W5%Re/W26%Re (Bucose)	7	Pt10%Rh/Pt40%Rh	8	Exergen K80 I.R pyrometer
Custom downloads (replace C)																								
Q	Custom curve																							
D	D thermocouple																							
E	E thermocouple																							
1	Ni/Ni18%Mo																							
2	Pt20%Rh/Pt40%Rh																							
3	W/W26%Re (Engelhard)																							
4	W/W26%Re (Hoskins)																							
5	W5%Re/W26%Re (Engelhard)																							
6	W5%Re/W26%Re (Bucose)																							
7	Pt10%Rh/Pt40%Rh																							
8	Exergen K80 I.R pyrometer																							
Table 1 A 4-20mA linear Y 0-20mA linear W 0-5Vdc linear G 1-5Vdc linear V 0-10Vdc linear																								



Comms H	
XX	None fitted
A2	232 Modbus
Y2	2W 485 Modbus
F2	4W 485 Modbus
AE	232 Bisync ⁽⁹⁾
YE	2W 485 Bisync ⁽⁹⁾
FE	4W 485 Bisync ⁽⁹⁾
PB	Profibus
DN	DeviceNet

Comms J	
XX	None fitted
A2	232 Modbus
Y2	2W 485 Modbus
F2	4W 485 Modbus
M1	232 Master
M2	2W 485 Master
M3	4W 485 Master

Manual	
ENG	English
FRA	French
GER	German
SPA	Spain
ITA	Italian
NED	Dutch
SWE	Swedish


Toolkit Functions	
XX	Standard
U1	Toolkit level 1 ⁽⁹⁾
U2	Toolkit level 2 ⁽⁹⁾

Technical Support	
TS1	1 Hour
TS2	2 Hours
TS4	4 Hours
TS8	8 Hours
TS0	NONE

Config Tools	
XX	None
IT	iTools

Hardware notes:

1. Basic Controller/Programmer includes 8 digital registers, 4 timers and 4 totalisers.
2. Toolkit 1 includes 16 analogue, 16 digital, pattern generator, digital programmer, analogue switch and 4 user values.
3. Toolkit 2 includes Toolkit 1 plus extra 8 analogue, 16 digital\operations and 8 user values.
4. Dual analogue input suitable for Carbon Probes. (Inputs not isolated from each other)
5. EI-Bisync includes only a subset of parameters.
6. The HR module has 1 high resolution DC output and 1 24Vdc power supply.

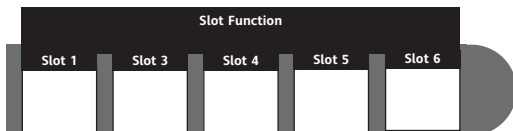


Analogue Input	
XXX	None
P2-	PV Loop 2
P3-	PV Loop 3
S1-	SP Loop 1
S2-	SP Loop 2
S3-	SP Loop 3
A1-	Aux. PV Loop 1
A2-	Aux. PV Loop 2
A3-	Aux. PV Loop 3
L1-	Ratio Lead PV Loop 1
L2-	Ratio Lead PV Loop 2
L3-	Ratio Lead PV Loop 3
For input range select third digit from table 1	

Slot Function	
XXX	Unconfigured
1-	Loop no. 1
2-	Loop no. 2
3-	Loop no. 3
Single relay, triac, logic	
-HX	Heat
-CX	Cool
Dual relay or triac	
-HC	PID Heat & Cool
-VH	VP Heat
-AA	FSH & FSH
-AB	FSH & FSL
-AC	DH & DL
-AD	FSH & DH
-AE	FSL & DL
-AF	FSL & FSL
-AG	FSH & DB
-AH	FSL & DB
-AJ	DB & DB
HHX	Heat output for loops 1 & 2
CCX	Cool OP's loops 1 & 2
P12	Prog events 1 & 2
P34	Prog events 3 & 4
P56	Prog events 5 & 6
P78	Prog events 7 & 8
Triple logic output	
-HX	CH1 Heat
-CX	CH1 Cool
-HC	CH 1 Heat, CH2 Cool
HHX	Heat output loops 1 & 2
HHH	Heat output for loops 1, 2 & 3
Single DC outputs	
-H-	PID Heat
-C-	PID Cool
-T-	PV retransmission
-S-	SP retransmission
For output range select third digit from table 1	
Precision PV input	
-PV	PV input module
-PA	Aux PV input (8)
-PL	Ratio lead input
Analogue input	
-R-	Setpoint
For input range select third digit from table 1	
Aux. & lead PV inputs	
-L-	Ratio lead input
-B-	Aux. PV input
For input range select third digit from table 1	
Potentiometer input	
-VF	VP Heat feedback
-RS	Remote SP
Dual DC 4-20mA/24Vdc PSU Output	
HHX	Heat output for loops 1 & 2
-HC	Heat Cool
-HT	CH1 Heat, Ch 2 PSU
TTX	Both channels PSU
High Resolution DC OP	
-TA	4-20mA PV Retrans
-TV	0-10V PV Retrans
-SA	4-20mA SP Retrans
-SV	0-10V SP Retrans


General notes:

1. Loop 1 PV defaults to main PV input on microboard. Loop 2 and 3 PV inputs must be fitted in I/O slots 3 or 6 or be assigned to the analogue input.
2. Alarm configuration refers to loop alarms only. One selection is allowed per loop. Additional alarms are available for the user to configure.
3. Thermocouple and RTD inputs assume sensor min and max values with no decimal point.
4. Linear inputs are ranged 0-100%, no decimal point.
5. Temperature units will be °C unless ordered by USA where °F will be used.
6. Remote setpoints assume loop min & max ranges.
7. VP1,VP2, VP3 and VP4 are not available with override function.
8. For Cascade and Override inputs only.
9. HR module should be used in feedback mode, please refer to TIBC160.


Dimensional details

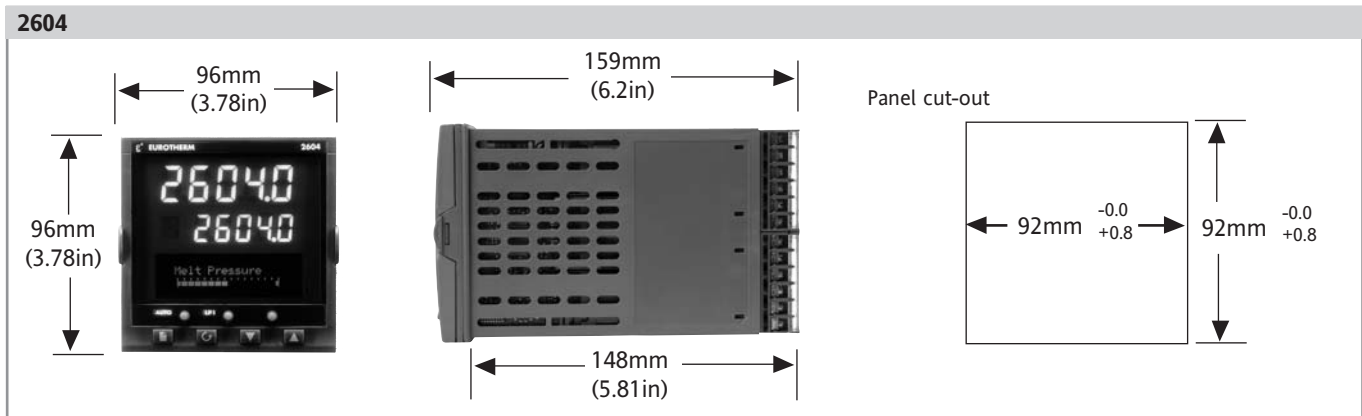

Rear terminal connections

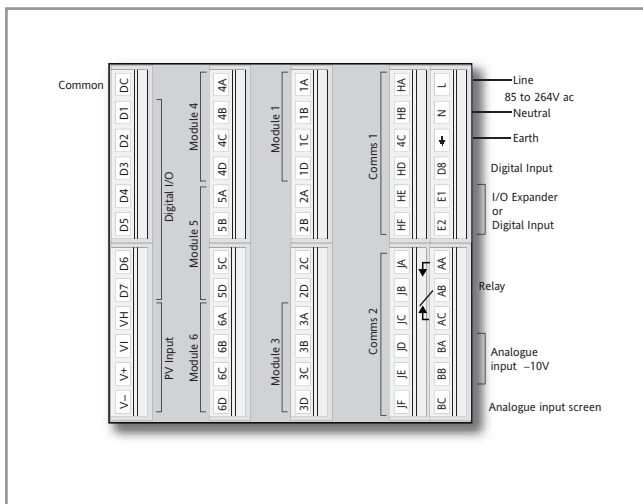

Isolation

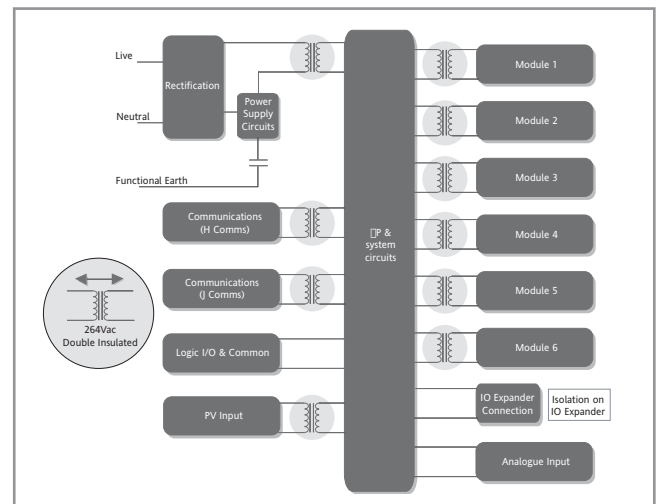

Eurotherm: International sales and service

AUSTRALIA Sydney
Eurotherm Pty. Ltd.
T (+61 2) 9838 0099
E info.au@eurotherm.com

AUSTRIA Vienna
Eurotherm GmbH
T (+43 1) 7987601
E info.at@eurotherm.com

BELGIUM & LUXEMBURG Moha
Eurotherm S.A./N.V.
T (+32) 85 274080
E info.be@eurotherm.com

BRAZIL Campinas-SP
Eurotherm Ltda.
T (+5519) 3707 5333
E info.br@eurotherm.com

DENMARK Copenhagen
Eurotherm Danmark AS
T (+45 70) 234670
E info.dk@eurotherm.com

FINLAND Abo
Eurotherm Finland
T (+358) 22506030
E info.fi@eurotherm.com

FRANCE Lyon
Eurotherm Automation SA
T (+33 478) 664500
E info.fr@eurotherm.com

GERMANY Limburg
Eurotherm Deutschland GmbH
T (+49 6431) 2980
E info.de@eurotherm.com

HONG KONG & CHINA
Eurotherm Limited North Point
T (+85 2) 28733826
E info.hk@eurotherm.com

Guangzhou Office
T (+86 20) 8755 5099
E info.cn@eurotherm.com

Beijing Office
T (+86 10) 6567 8506
E info.cn@eurotherm.com

Shanghai Office
T (+86 21) 6145 1188
E info.cn@eurotherm.com

INDIA Chennai
Eurotherm India Limited
T (+91 44) 24961129
E info.in@eurotherm.com

IRELAND Dublin
Eurotherm Ireland Limited
T (+353 1) 4691800
E info.ie@eurotherm.com

ITALY Como
Eurotherm S.r.l.
T (+39 31) 975111
E info.it@eurotherm.com

KOREA Seoul
Eurotherm Korea Limited
T (+82 31) 2738507
E info.kr@eurotherm.com

NETHERLANDS Alphen a/d Rijn
Eurotherm B.V.
T (+31 172) 411752
E info.nl@eurotherm.com

NORWAY Oslo
Eurotherm A/S
T (+47 67) 592170
E info.no@eurotherm.com

POLAND Katowice
Invensys Eurotherm Sp z o.o.
T (+48 32) 2185100
E info.pl@eurotherm.com

SPAIN Madrid
Eurotherm España SA
T (+34 91) 6616001
E info.es@eurotherm.com

SWEDEN Malmo
Eurotherm AB
T (+46 40) 384500
E info.se@eurotherm.com

SWITZERLAND Wollerau
Eurotherm Produkte (Schweiz) AG
T (+41 44) 7871040
E info.ch@eurotherm.com

UNITED KINGDOM Worthing
Eurotherm Limited
T (+44 1903) 268500
E info.uk@eurotherm.com
www.eurotherm.co.uk

U.S.A. Leesburg VA
Eurotherm Inc.
T (+1 703) 443 0000
E info.us@eurotherm.com
www.eurotherm.com

ED52

© Copyright Eurotherm Limited 2006

Invensys, Eurotherm, the Eurotherm logo, Chessell, EurothermSuite, Mini8, Eyon and Wonderware are trademarks of Invensys plc, its subsidiaries and affiliates. All other brands may be trademarks of their respective owners. All rights are strictly reserved. No part of this document may be reproduced, modified, or transmitted in any form by any means, nor may it be stored in a retrieval system other than for the purpose to act as an aid in operating the equipment to which the document relates, without the prior written permission of Eurotherm limited.

Eurotherm Limited pursues a policy of continuous development and product improvement. The specifications in this document may therefore be changed without notice. The information in this document is given in good faith, but is intended for guidance only. Eurotherm Limited will accept no responsibility for any losses arising from errors in this document.